QUICK INSTALLATION GUIDE


SMILE-G3-T12-INV / SMILE-G3-T15-INV / SMILE-G3-T20-INV

01 Product Overview

- (1) Grounding Points
- (2) Communication Ports
- (3) Wi-Fi Port
- (4) Battery Circuit Breaker
- (5) BAT Connector
- (6) BAT + Connector
- (7) PV + Connectors / PV Connectors
- (8) PV Switch
- (9) Backup Connector
- (10) Grid Connector
- (11) Parallel Communication Ports (Reserve)
- (12) LED/LCD Display

O2 Accessories and Installation Tools

2.1 Scope of Delivery

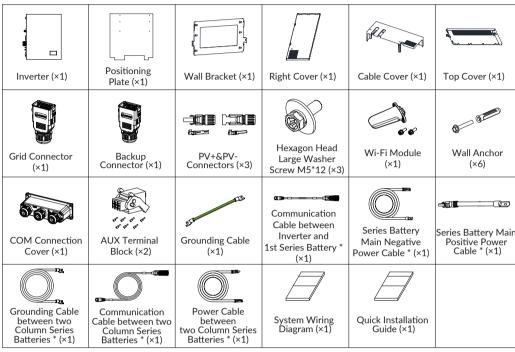

^{* :} optional, suitable for series batteries.

4.2 AC Connection

MARNING

Select a suitable circuit breaker and consider the factors influencing the ampacity of the cable: type of cable used, ambient temperature around the cable, type of cable routing, bundling of cables. Other influences on dimensioning: loop impedance, mutual heating of circuit breakers, ambient temperature at the circuit breaker, selectivity, type of connected device. If these factors are ignored, it increases the danger of the circuit breaker tripping under normal operating conditions.

AC connection recommendation for SMILE-G3-T12-INV

| Description | Max. Current | Recommended AC Circuit Breaker Type | Recommend cable cross section | |
|-----------------|--------------|-------------------------------------|-------------------------------|--|
| Grid Side 24.6A | | 40A | 6~10mm² | |
| Backup Side | 21.7A | 32A | 6~10mm² | |


AC connection recommendation for SMILE-G3-T15-INV


| Description | Max. Current | Recommended AC Circuit Breaker Type | Recommend cable cross section | |
|---------------------------------|--------------|-------------------------------------|-------------------------------|--|
| Grid Side 29A Backup Side 27.2A | | 50A | 6~10mm² | |
| | | 40A | 6~10mm² | |


AC connection recommendation for SMILE-G3-T20-INV


| Description | Max. Current | Recommended AC Circuit Breaker Type | Recommend cable cross section | |
|-----------------|--------------|-------------------------------------|-------------------------------|--|
| Grid Side 36.2A | | 50A | 6~10mm² | |
| Backup Side | 36.2A | 50A | 6~10mm² | |


Grid and Backup Connection

















2.2 Installation Tools

V01



Crimping Pliers

(Model:PV-CZM-22100)

PH2×150mm

PH2 Screwdriver

Cord End Terminal

Blade width:1.2/2.5

Current Clamp



Spirit Level




Hammer Drill Bit φ10





Multimeter

03 Mounting the Inverter

Before installing the inverter, please ensure that the battery has been installed properly.







04 Electrical Connection

DANGER

You must protect each inverter with an individual grid/backup circuit breaker in order to ensure that the inverter can be disconnected safely.


MARNING

Before doing electrical connection, please ensure the PV switch & all AC and DC circuit breakers are switched OFF and cannot be reactivated.




Please refer to System Wiring Diagram for detailed wiring.


4.1 Grounding Connection

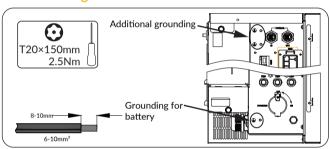


02


01










Disassembling











4.3 PV Connection















4.4 BAT Power Connection

DANGER

Danger to life due to burns caused by electric arcs through short-circuit currents.


Short-circuit currents in the battery can cause heat build-up and electric arcs. Heat build-up and electric arcs may result in lethal injuries due to burns.


- Disconnect the battery from all voltages sources prior to performing any work on the battery.
- •Disconnect the inverter from all voltages sources prior to performing any work on the inverter.
- DO NOT short-circuit the battery terminals. First, complete the main negative terminal connection between battery and inverter, and then complete the main positive terminal connection between battery and inverter.
- Observe battery safety information provided in the Installation&Operation&Maintenance Manual.

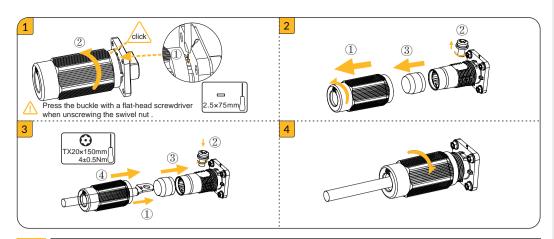

Communication Connection


5.1 Wi-Fi Connection





5.2 Other Communication Connection

AUX / LAN / DRM&RRCR / Meter / RS485 / BMS Connection

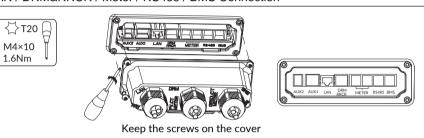


| D1.46 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
|--------|----------|---------------|----------|-------------|-------------|-----------|---------------|---|
| BMS | / | RS485_A4 | / | CAN1_H | CAN1_L | / | RS485_B4 | / |
| RS 485 | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
| K5 485 | 12V | DEBUG_RXD_COM | GND | RS 485_ B5 | RS 485_A5 | / | DEBUG_TXD_COM | / |
| | 1 | 2 | 3 | 4 | 5 | 6 | 7 | 8 |
| METER | / | / | RS485_A7 | / | / | RS485_B7 | / | / |
| DDM | 1 | 2 | 3 | 4 | 5 | 6 | / | / |
| DRM | DRED 1/5 | DRED 2/6 | DRED 3/7 | DRED 4/8 | REF GEN/0 | COMLOAD/0 | / | / |
| DDCD | 1 | 2 | 3 | 4 | 5 | 6 | | |
| RRCR | K1 | K2 | K3 | K4 | 3.3V | / | | |
| AUX1 | 1 | 2 | 3 | 4 | 5 | 6 | | |
| AUXI | DO1_NO | DO1_COM | DO1_NC | DI_negative | DI_positive | GND | | |
| AUX2 | 1 | 2 | 3 | 4 | 5 | 6 | | |
| AUXZ | DO2 NO | DO2 COM | DO2 NC | DI negative | DI positive | GND | | |


Mounting the Covers

CAUTION


Make sure all the wiring has been done and the energy storage system works normally, then mount the covers of the inverter.

8.1 Mounting the Top Cover



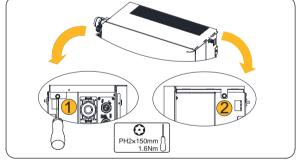



8.2 Mounting the Right Cover




8.3 Mounting the Cable Cover










Wiring the Communication Cables to the Inverter

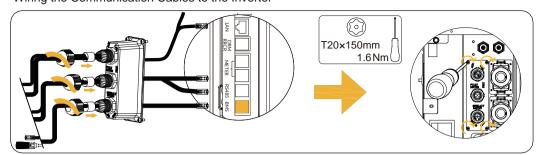

Commissioning

WARNING

Never power on the energy storage system without the correct and reliable installation and electrical connection.

Follow the steps in the COMMISSIONING GUIDE AND REPORT to download AlphaESS APP, register your account, power on the system, configure Wi-Fi module, set system parameter and operate the system. After completing the commissioning, please submit the commissioning report.

Power ON / OFF the Energy Storage System Procedure


Procedure for Powering ON the System

- 1) Switch on the battery circuit breaker at the left middle of the inverter.
- 2) Switch on the battery circuit breakers of all batteries.
- 3) Shortly press the battery power buttons of the parallel batteries. For more than one parallel battery installed, please shortly press all power buttons within 30 seconds. (For series batteries, please skip this step.)
- 4) Switch on the AC circuit breaker between the grid port of the inverter and the grid.
- 5) Switch on the AC circuit breaker between the backup port of the inverter and the loads.
- 6) Switch on the PV switch between the PV strings and the inverter if there is any.
- 7) Switch on the PV switch at the lower left of the inverter.
- 8) Switch on the AC circuit breaker (if there is any) between the PV-inverter and the grid.

Procedure for Powering OFF the System

- 1) Switch off the AC circuit breaker between the backup port of the inverter and the loads.
- 2) Switch off the PV switch at the lower left of the inverter.
- 3) Press and hold the power button of the battery for 6 seconds, which is near the battery circuit breaker. (For series batteries, please skip this step.)
- 4) Switch off the battery circuit breakers of all the batteries.
- 5) Switch off the battery circuit breaker which is on the left side of the inverter.
- 6) Switch off the AC circuit breaker (if there is any) between the PV-inverter and the grid.
- 7) Switch off the AC circuit breaker bettwen the grid port of the inverter and the grid.

05

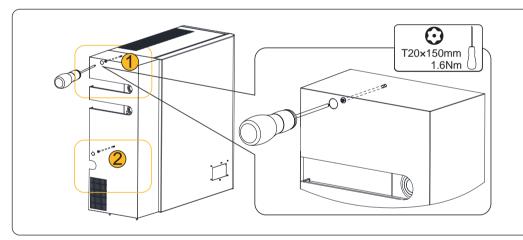

For more information, please download the user manual and other technical documents.







System Installation Manual

APP Manual (Installer)



AlphaCloud Manual

(Installer)

APP Manual

(End-user)





AlphaCloud Manual (End-user)

System Datasheet

80